
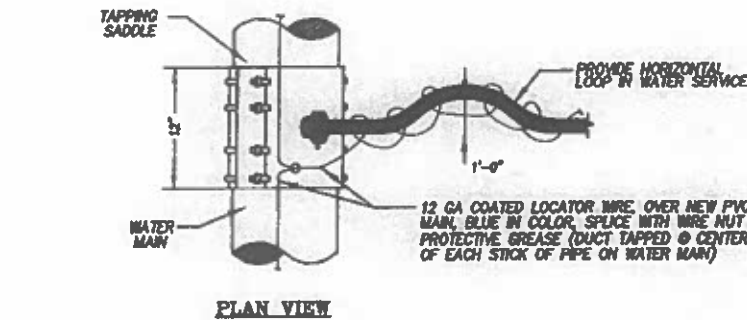


TYPICAL 2" WATER SERVICE CONNECTION IN ALLEY

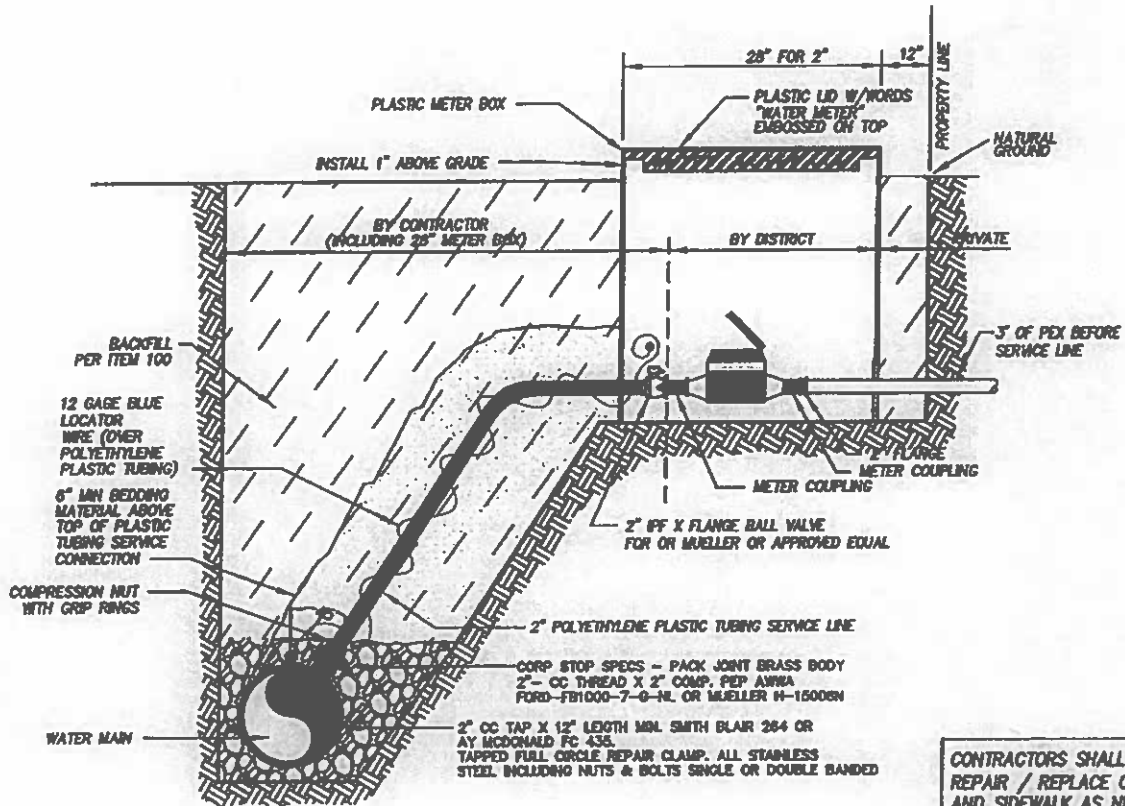

CONTRACTORS SHALL REPAIR / REPLACE CURB AND SIDEWALK AS NECESSARY FOR INSTALLATION OF SERVICES

NOTE:
PAVEMENT PATCH FOR SERVICES CROSSING STREET TYPICALLY 4 IN. WIDE

- NOTE:**
1. ALL BRASS GOODS SHALL COMPLY TO AWWA SPECS. QM. C-800-55
 2. DO NOT CONNECT LOCATOR WIRE TO CORPORATION OR CURB STOP

GENERAL NOTES:

1. THE UTILITY CONTRACTOR IS TO INSTALL A NEW SERVICE LINE AT EACH INDIVIDUAL LOT OR TRACT. WATER SERVICE SHALL BE LOCATED 6" TO THE RIGHT OF THE CENTER LINE OF THE LOT WHEN VIEWED FROM THE MAIN.
2. THE SIZE OF THE SERVICE LINE IS TO BE AS NOTED ON THE PLAN SHEETS.
3. UPON COMPLETION OF THE SERVICE LINE, THE CONTRACTOR WILL LEAVE THE CORPORATION STOP OPEN AND THE CURB STOP CLOSED.
4. THE SERVICE LINE UP TO THE CURB STOP WILL BE INCLUDED IN THE STERILIZATION AND PRESSURE TESTING OF THE WATER MAIN.
5. THE BACKFILL AND CLEANUP REQUIREMENTS FOR SERVICE LINES ARE THE SAME AS ON WATER MAINS.
6. SERVICE CONNECTIONS ON 1" WILL HAVE 24" DIA. METER BOXES.
7. SERVICE CONNECTIONS IN PAVED AREAS WILL HAVE 14" X 18" X 28" CAST IRON METER BOXES. BOX TO BE FLUSH WITH PAVEMENT.
8. INSTALL LOCATOR WIRE OVER PLASTIC TUBING & PVC MAIN. LOCATOR WIRE-- STRANDED BLUE. USE SINGLE LENGTH OF WIRE WITH INSULATION INTACT. COAT AT THE END OF THE WIRE WITH SCOTCHCOOTE ELECTRICAL COATING OR EQUAL.